


If a vision disability is preventing you from reading the following document, call the Department of Public Works at (603)528-6379 for assistance.

D13-Trench Section for Polyvinyl Chloride Pipe SDR-35

(not to scale)

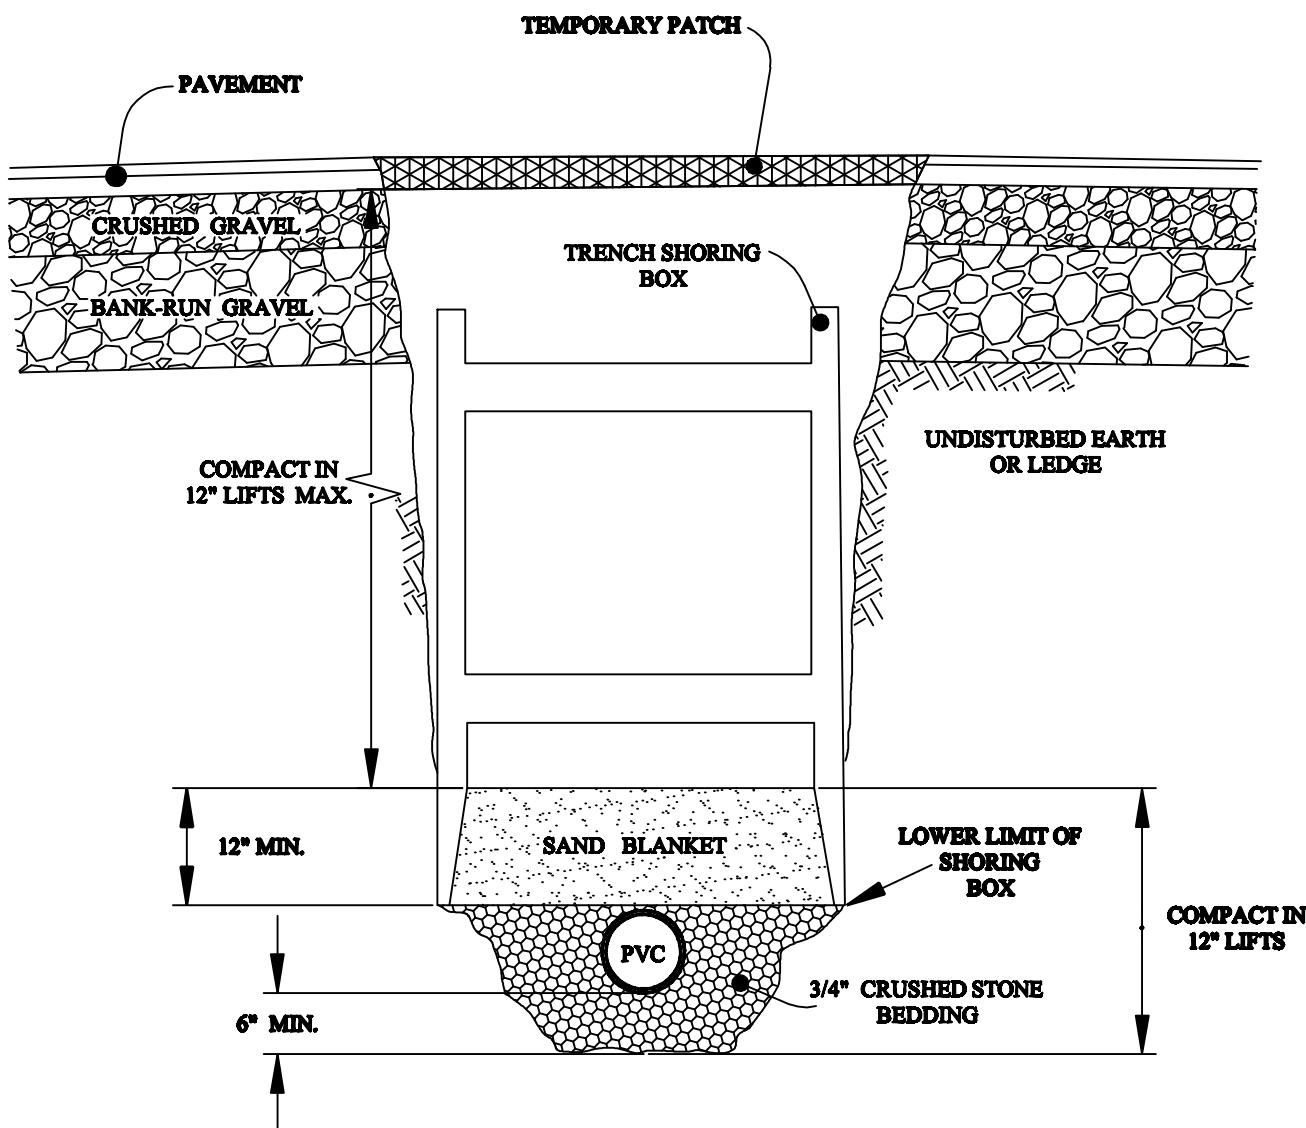

NOTE: THESE STANDARDS ARE TO BE CONSIDERED AS MINIMUM REQUIREMENTS. ANY DEVIATION FROM THESE STANDARDS WILL REQUIRE THE LACONIA DEPT. OF PUBLIC WORKS APPROVAL.



Department of Public Works

27 Bisson Avenue
Laconia, NH 03246

Phone: 603-528-6379
Fax: 603-527-1298