


# D13-Trench Section for Polyvinyl Chloride Pipe

## SDR-35

(not to scale)

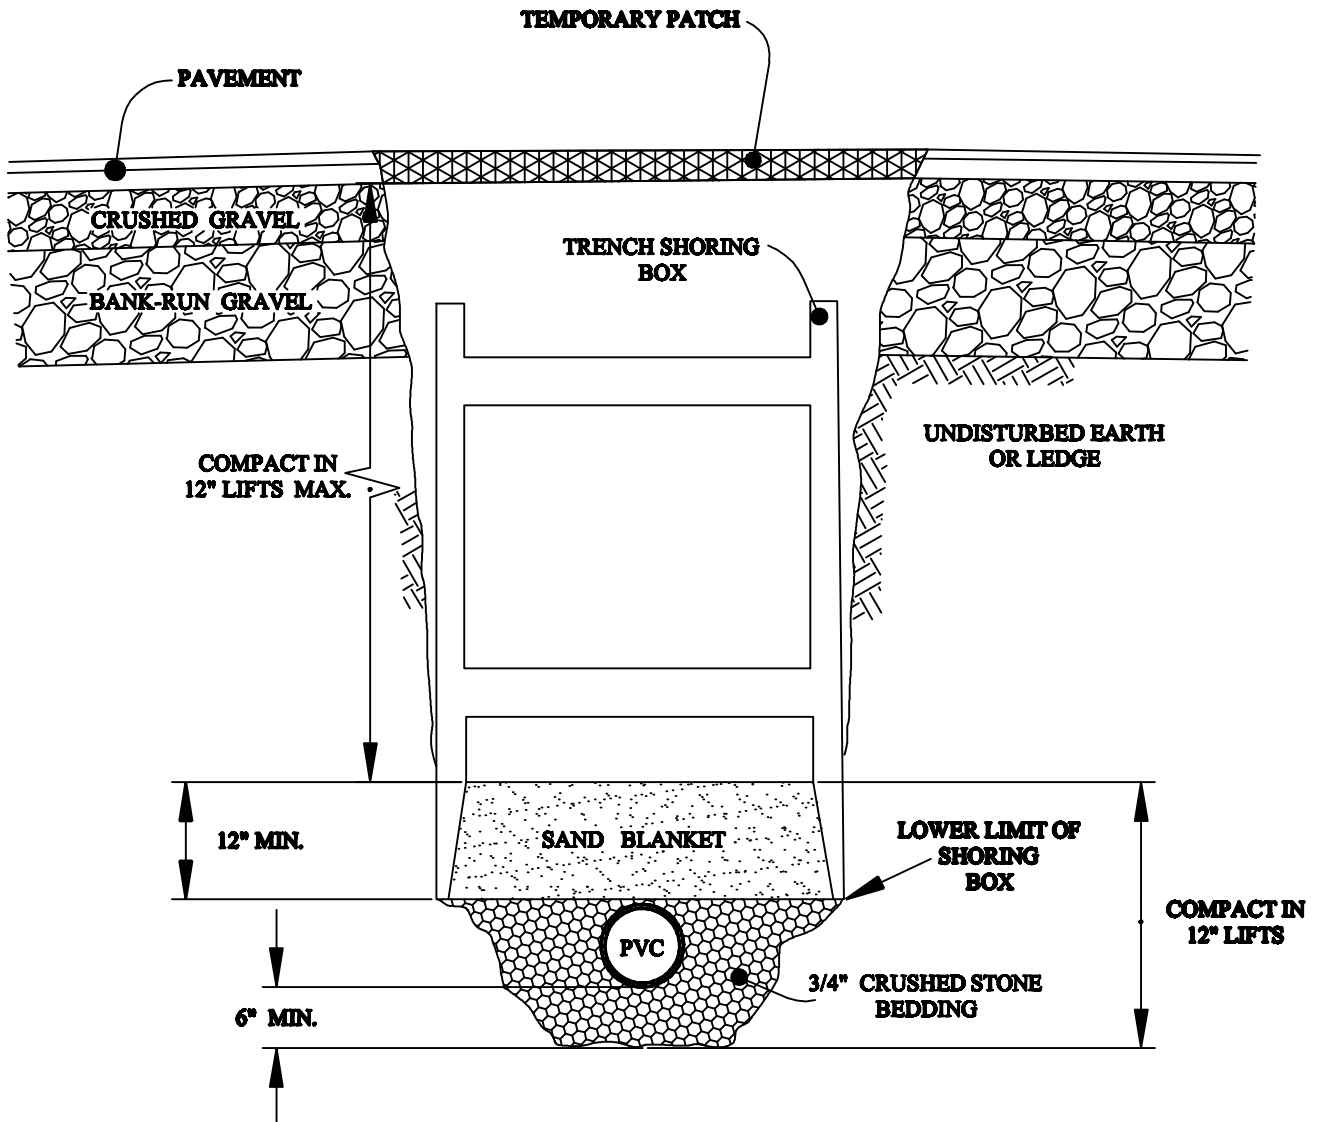

NOTE: THESE STANDARDS ARE TO BE CONSIDERED AS MINIMUM REQUIREMENTS. ANY DEVIATION FROM THESE STANDARDS WILL REQUIRE THE LACONIA DEPT. OF PUBLIC WORKS APPROVAL.



### Department of Public Works

27 Bisson Avenue  
Laconia, NH 03246

Phone: 603-528-6379  
Fax: 603-527-1298