



# D-25 Underground Utility Conduit Trench Installation Detail

TYPICAL TRENCH CROSS-SECTION WITH STACKED CONDUIT CONFIGURATION  
(N.T.S.)

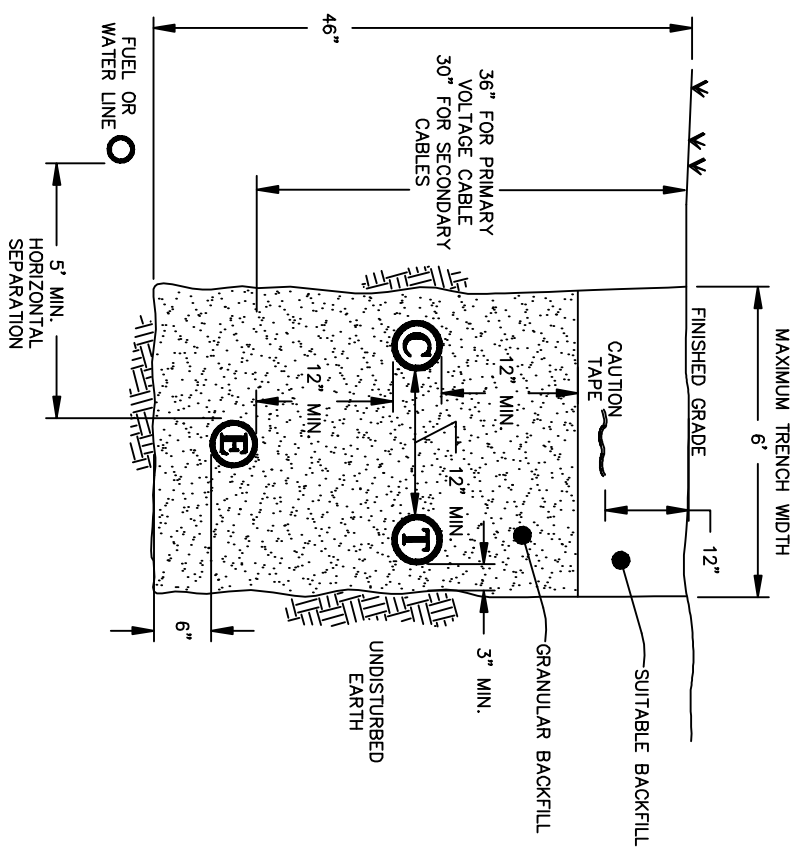

TYPICAL TRENCH CROSS-SECTION WITH SIDE-BY-SIDE CONDUIT CONFIGURATION  
(N.T.S.)

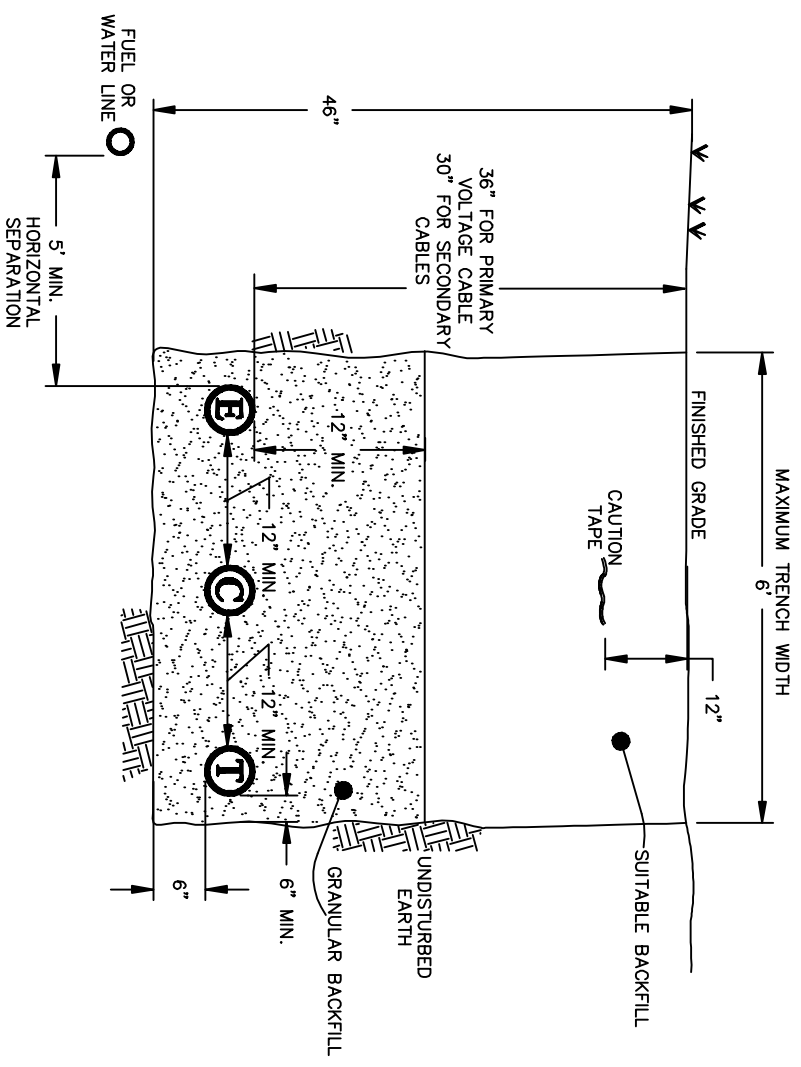

NOTE: THESE STANDARDS ARE TO BE CONSIDERED AS MINIMUM REQUIREMENTS. ANY DEVIATION FROM THESE STANDARDS WILL REQUIRE THE LACONIA DEPT. OF PUBLIC WORKS APPROVAL.

