


E. 1-Inch Residential - Low Hazard - Irrigation Line Prior To Domestic Meter

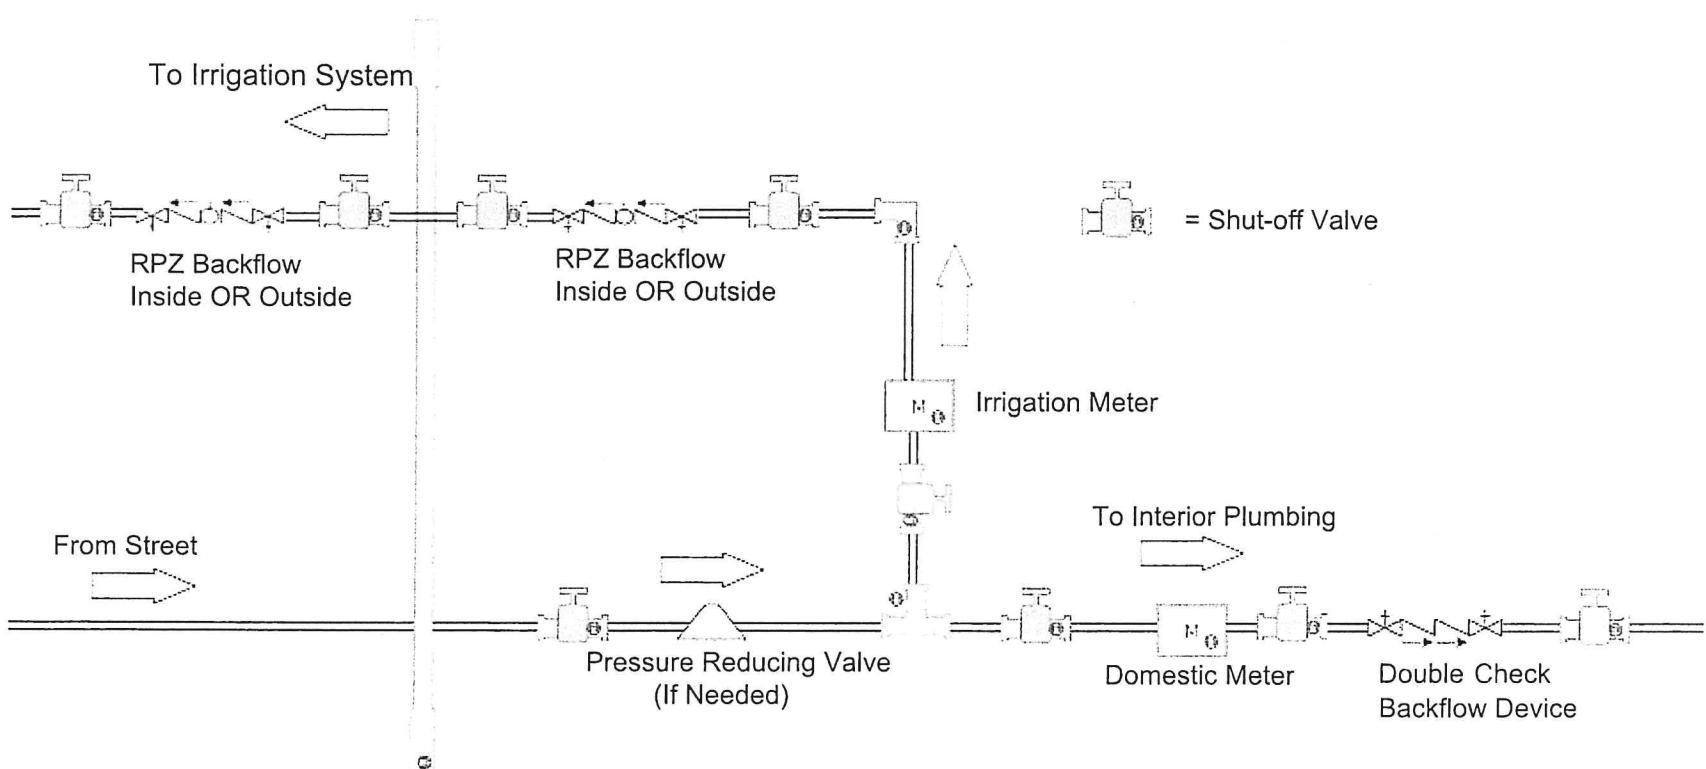

1. All Backflow devices to be installed according to manufacturer's specifications.
2. List of approved backflows can be found through the University of Southern California's Foundation for Cross-Connection Control and Hydraulic Research at <https://fccchr.usc.edu/list.html>
3. Meters and Couplings to be purchased from Laconia Water, or if supplied by others they must be approved by Laconia Water prior to installation.
4. No connections are to be made prior to backflow devices, unless approved by Laconia Water.